



FORM B 13.3

FIRE SAFETY CERTIFICATE RENEWAL (FSCR)

(See Rule 25)

Fire Safety Certificate Approval (FSCA) No. FSCA/O/CFOAMC/2022/00021328

Date: 09/03/2024

FSC Safety Certificate Renewal (FSCR) No. FSCA/O/CFOAMC/2022/00021328/R1

Building Occupancy/Category: Educational (non-residential)

To,

Chintookumar Chunilal Vaghela

OPP. TIRTHNAGAR, VIBH AG- 1, MEMNAGAR, AHM EDABAD., OPP. TIRTHNAGAR, VIBH AG- 1, MEMNAGAR, AHM EDABAD., OPP. TIRTHNAGAR, VIBH AG- 1, MEMNAGAR, AHM EDABAD., OPP. TIRTHNAGAR, VIBH AG- 1, MEMNAGAR, AHMEDABAD., Ahmedabad MC 380052

Fire Region: Ahmedabad MC

Mobile No: 9979852186 Email ID: license@hbkapadia.com

This has reference to your Application No. 2024/00050229 dated 07/03/2024 for Fire Safety Certificate Renewal (FSCR) for the building/premise THE HB KAPADIA NEW PRIMARY SCHOOL AND THE HB KAPADIA NEW HIGH SCHOOL THE HB KAPADIA NEW PRIMARY SCHOOL AND THE HB KAPADIA NEW HIGH SCHOOL (name of the Building/ Project), as per below mentioned details:

1. TP Number: 1
2. FP Number: 97+98/1
3. Survey Number: 0
4. Village Name: OPP. TIRTHNAGAR, VIBH AG- 1, MEMNAGAR, AHMEDABAD.,
5. Name of Block(s): THE HB KAPADIA NEW PRIMARY SCHOOL THE HB KAPADIA NEW HIGH SCHOOL THE HB KAPADIA NEW PRIMARY SCHOOL

The building/premise was inspected on 09/03/2024 and all fire prevention, life safety and fire protection measures provided were found to be in proper and effective working condition. There are no changes in building/premise use or occupancy or in building design or structure.

Further, the following activities (as applicable) have been carried out towards meeting requirements of GFP&LSM Act-2013, GFP&LSM Rules-2014 & GFP&LSM Regulations-2023 as amended, or the then applicable GDCR:

1. Emergency drill was carried out on 09/03/2024
2. Six monthly inspection was done on 09/03/2024



Digitally Verified

Digitally verified by: Dhruv Nitinkumar Soni
Fire Safety Officer - Specialist (FSO-S)
2021/000287

Date: 09/03/2024
Time: 02:28 PM



FSCA/O/CFOAMC/2022/00021328/R1

This is a digitally verified certificate, hence doesn't require physical signature. To validate authenticity of this certificate, scan the QR code or search the certificate details in appropriate section at www.gujfiresafetycop.in.

Please note that, apart from renewal, the building needs to be inspected every six months and a mock fire and emergency drill also needs to be conducted every six months. If there is a delay in scheduled inspection or mock drill, penalty shall be imposed. The Fire Safety Certificate renewal should be done timely after two years to avoid penalties.


The H. B. Kapadia New High School
Principal
CBSE Affiliated 430405
Memnagar, Ahmedabad.

Manager

The H. B. Kapadia New High School
CBSE Affiliated 430405
Memnagar, Ahmedabad.



The Fire Safety Certificate is renewed for a period of **two (2)** years upto **09/03/2026** in accordance with GFP&LSM Act-2013, GFP&LSM Rules-2014 & GFP&LSM Regulations-2023 and their amendments.

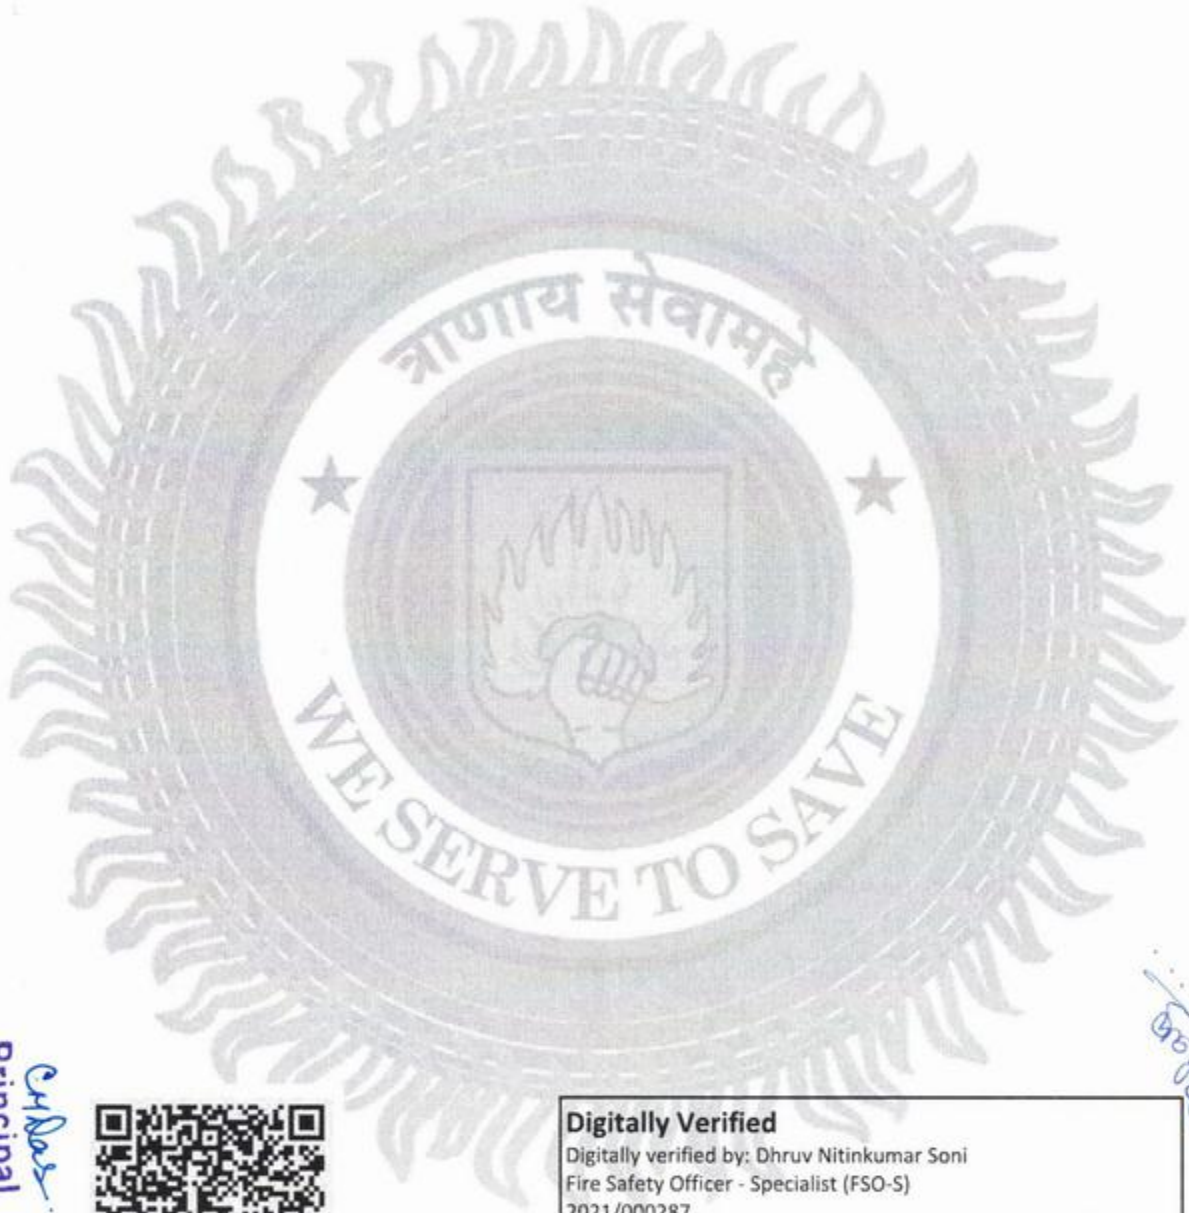

The H. B. Kapadia New High School
CBSE Affiliated 430405
Memnagar, Ahmedabad.

Principal

Signature



Digitally Verified

Digitally verified by: Dhruv Nitinkumar Soni
Fire Safety Officer - Specialist (FSO-S)
2021/000287

Date: 09/03/2024
Time: 02:28 PM



Manager

The H. B. Kapadia New High School

CBSE Affiliated 430405
Memnagar, Ahmedabad.

FSCA/O/CFOAMC/2022/00021328/R1

This is a digitally verified certificate, hence doesn't require physical signature. To validate authenticity of this certificate, scan the QR code or search the certificate details in appropriate section at www.gujfiresafetycop.in.

Please note that, apart from renewal, the building needs to be inspected every six months and a mock fire and emergency drill also needs to be conducted every six months. If there is a delay in scheduled inspection or mock drill, penalty shall be imposed. The Fire Safety Certificate renewal should be done timely after two years to avoid penalties.